



# Direct Vent Kit 1951217 Installation

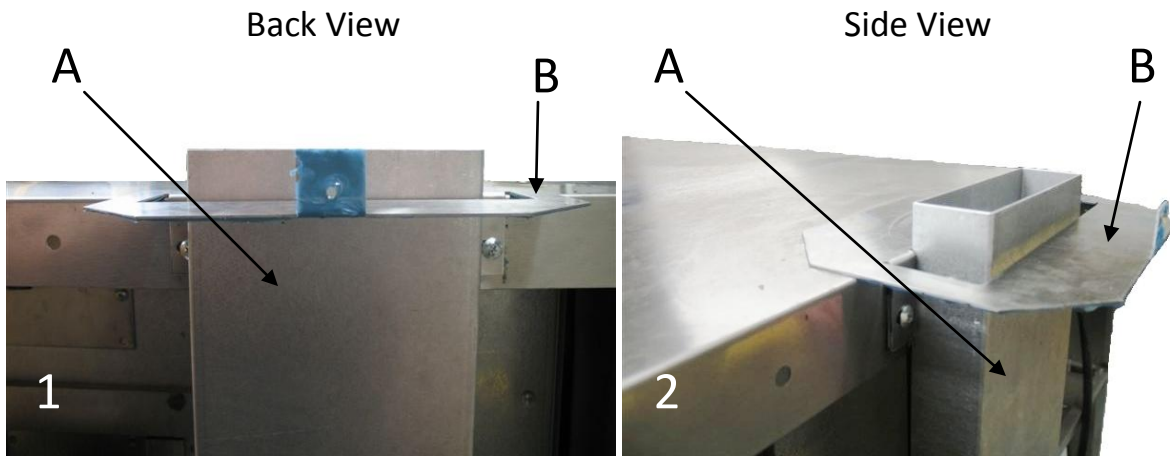

After removing the Flu (A – stacked flu shown, single flu installation follows the same procedure) by removing the 2 Philips screws and installing the Flu adapter (B – Remove protective coating before installation [shown for contrast]) the unit should appear as above.

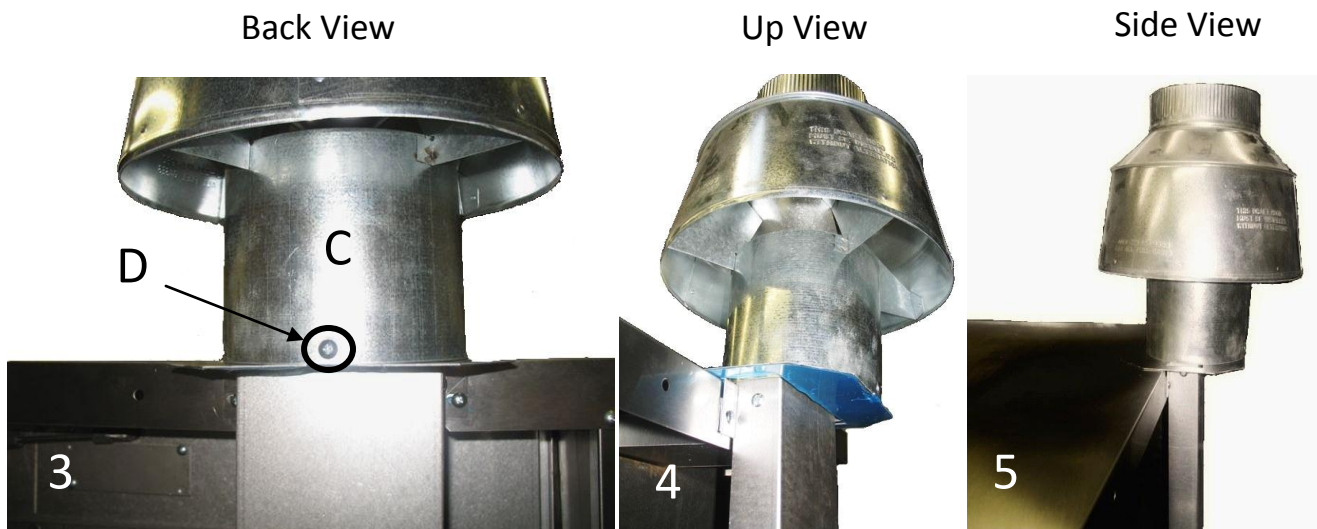

Now install the 6" Direct Vent Bell (C) to the Flu adapter with the single screw (D) as shown in figure 3. The unit is now ready to install the vent pipe according to your local building codes.